


TRANSFORMER AND
TRANSFORMER BOX PAD

SIDE VIEW

SECONDARY PEDESTAL

SIDE VIEW

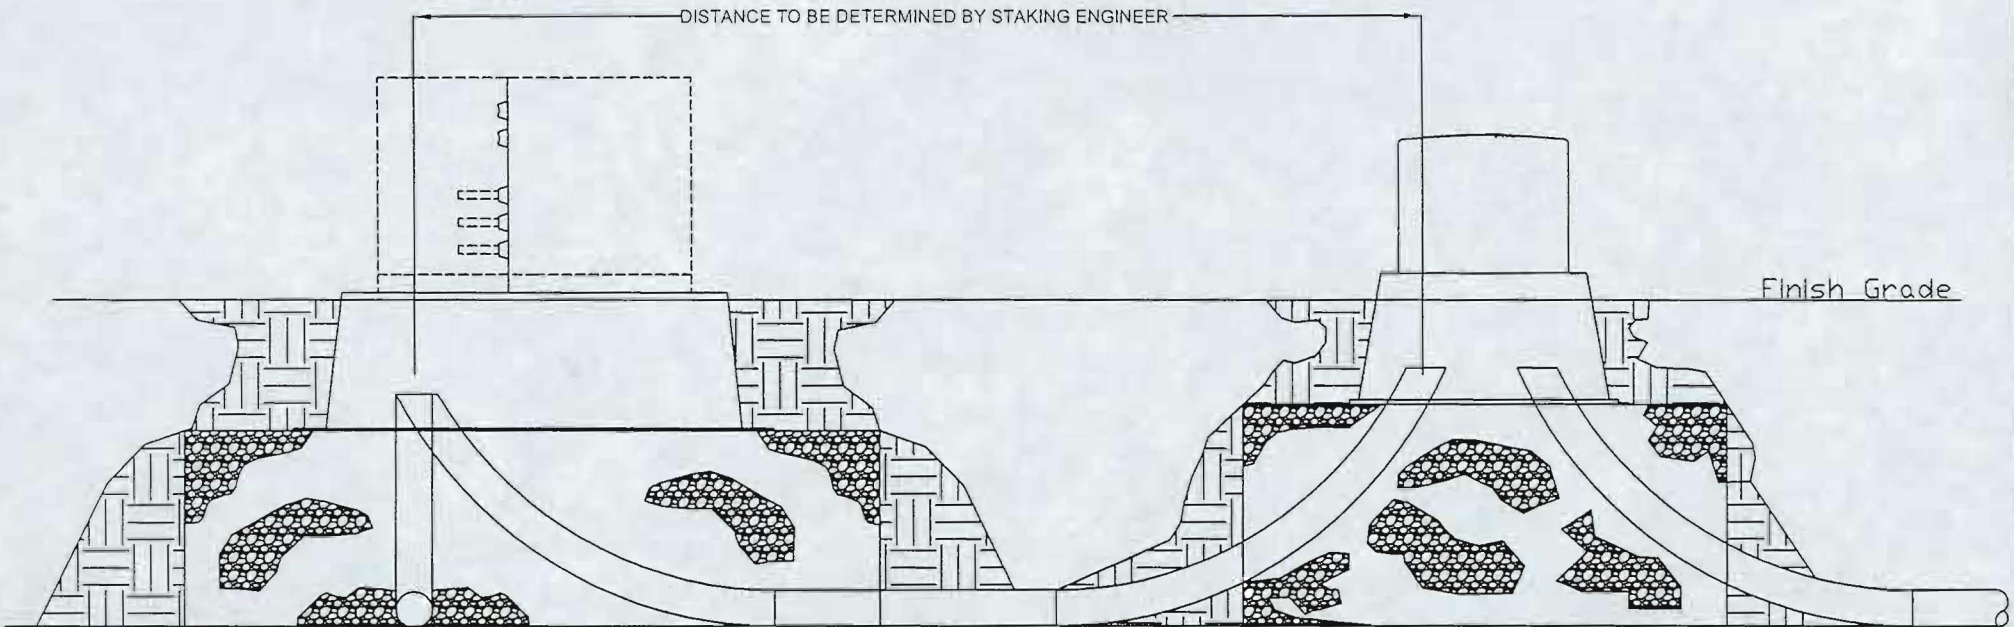

NOTE:

- 1.) MEMBER/DEVELOPER TO INSTALL UNDERGROUND FACILITIES AS DESIGNED BY THE STAKING ENGINEER. ANY DEVIATION MUST HAVE PRIOR APPROVAL FROM PIONEER
- 2.) MEMBER/DEVELOPER MUST CAP ANY EXPOSED SPARE ELBOWS OR CONDUIT AS REQUIRED
- 3.) SECURE ADDITIONAL 5' OF PULL STRING/TAPE TO CONDUIT CAP.
- 4.) SITE WORK MUST BE TO FINAL GRADE BEFORE UNDERGROUND FACILITIES CAN BE INSTALLED.
- 5.) PIONEER RESERVES THE RIGHT NOT TO CONNECT SERVICE IF PIONEER'S REPRESENTATIVE CONSIDERS THE INSTALLATION IS NOT INSTALLED TO SPECIFICATIONS.

PIONEER RURAL ELECTRIC CO-OP., INC.
PIQUA, OHIO 45356

TYPICAL TRANSFORMER
TO SEC PEDESTAL

Rev. 3/09