



### SIDE VIEW

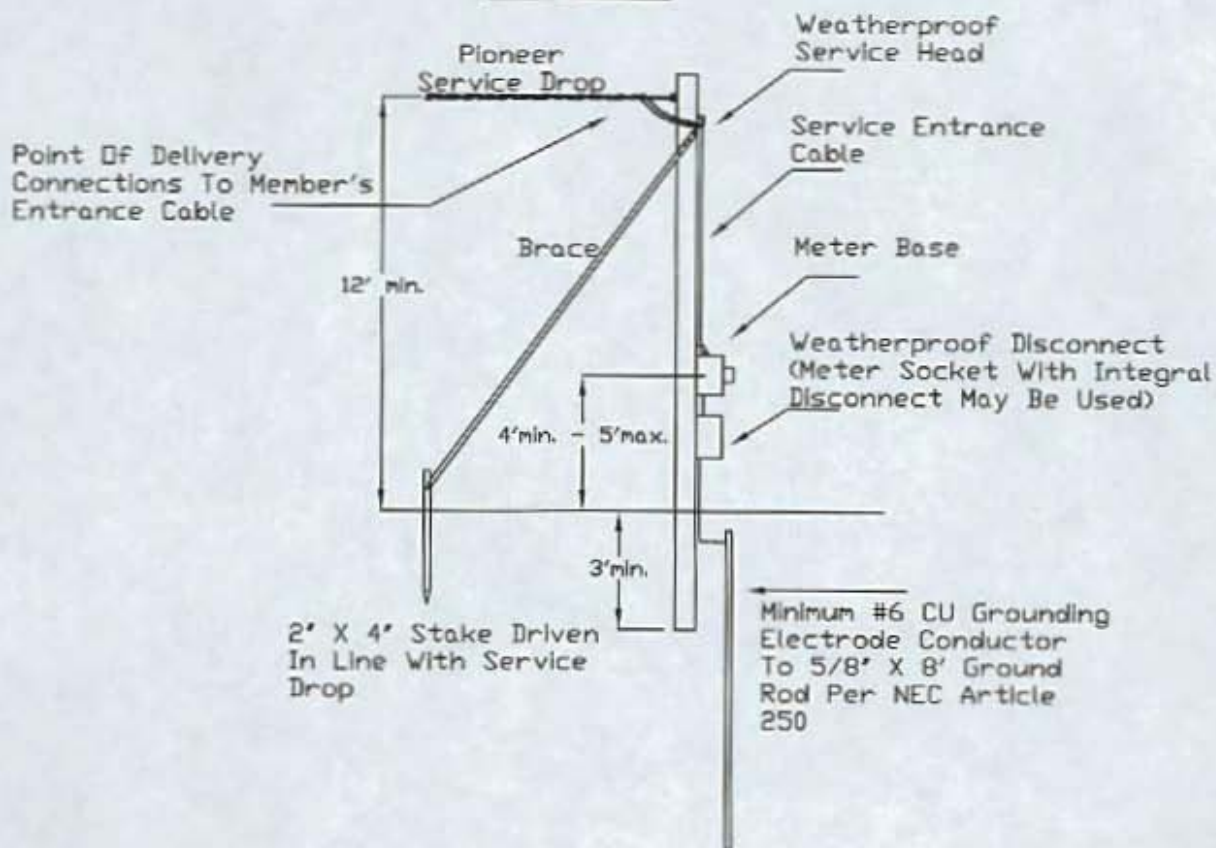

### TOP VIEW

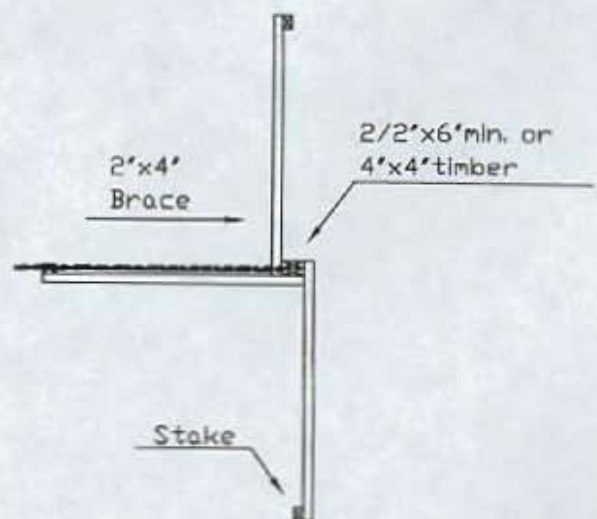

1. Location of temporary service shall be determined by a representative of Pioneer Electric Cooperative.
2. Pioneer shall furnish a 100 Ampere meterbase.
3. Member or Contractor shall furnish all materials and labor for the installation.
4. Pole or structure strength shall be at least equal to a 4' X 4' timber.
5. Weatherproof service head must be at least 12' above ground level and high enough for Pioneer's service drop to clear driveways and highways by 18'.
6. Weatherproof disconnect shall be a minimum 60 Ampere, fusible style or circuit breaker. Box shall be locked, with fuses or breakers in 'off' position when not in use.
7. Service entrance cable shall have an ampacity equivalent to the main disconnect.
8. All receptacle boxes shall be outdoor weatherproof and GFCI protected.
9. Wiring to receptacles shall have proper overcurrent protection for the size of conductor used.
10. Service must be grounded with an 8' driven ground rod and #6 solid copper grounding electrode conductor.
11. All construction must be in compliance with the requirements of the NEC.
12. Temporary service not to exceed 12 months in length of use.
13. Meterbase must be kept clear and accessible to Cooperative employees at all times.
14. Approved and released by local regulatory agency before permanent connections.

**PIONEER RURAL ELECTRIC CO-OP., INC.**  
**PIQUA, OHIO 45356**

**Overhead Temporary**  
**Served From Overhead Facilities Only**

Oct. 2004

Rev. 6/2005

PRE 1