



FRONT

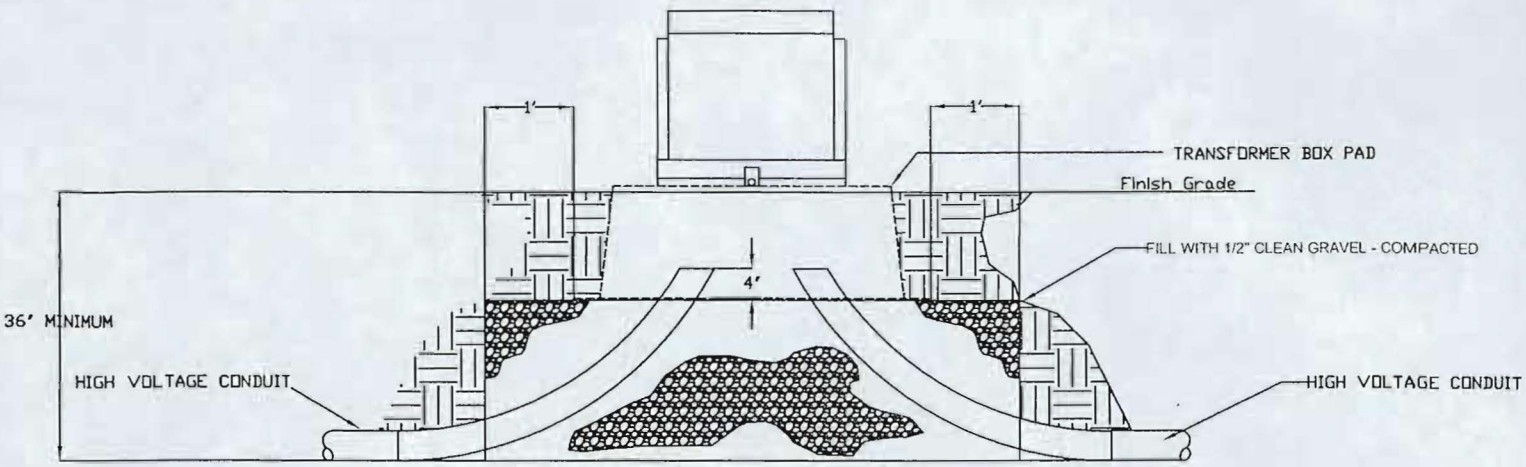


SIDE

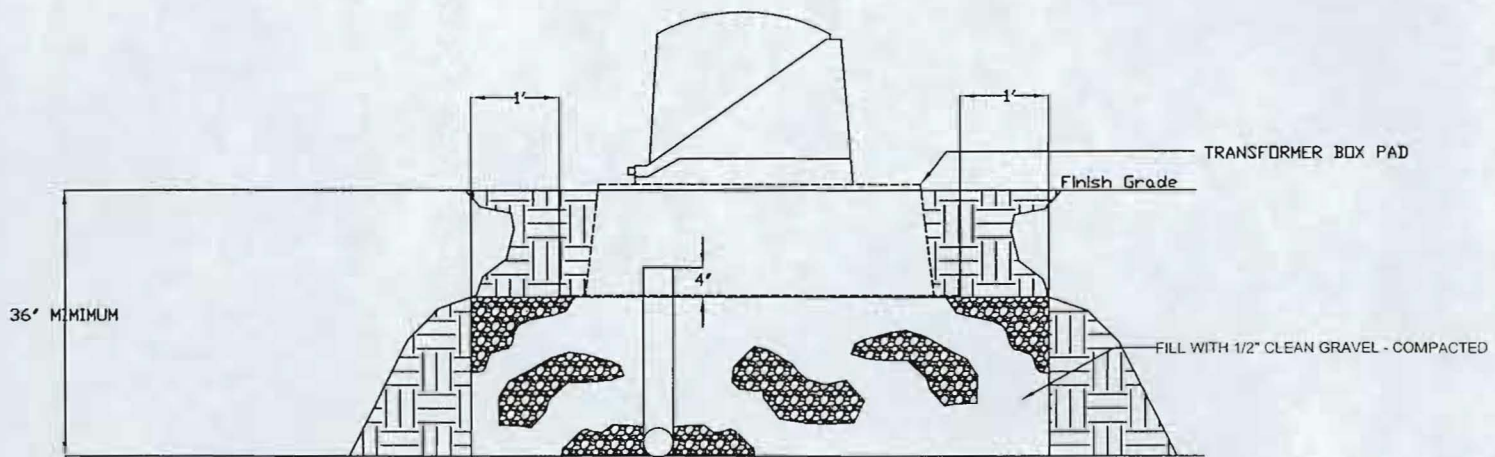

TRANSFORMER BOX PAD

PLAN VIEW

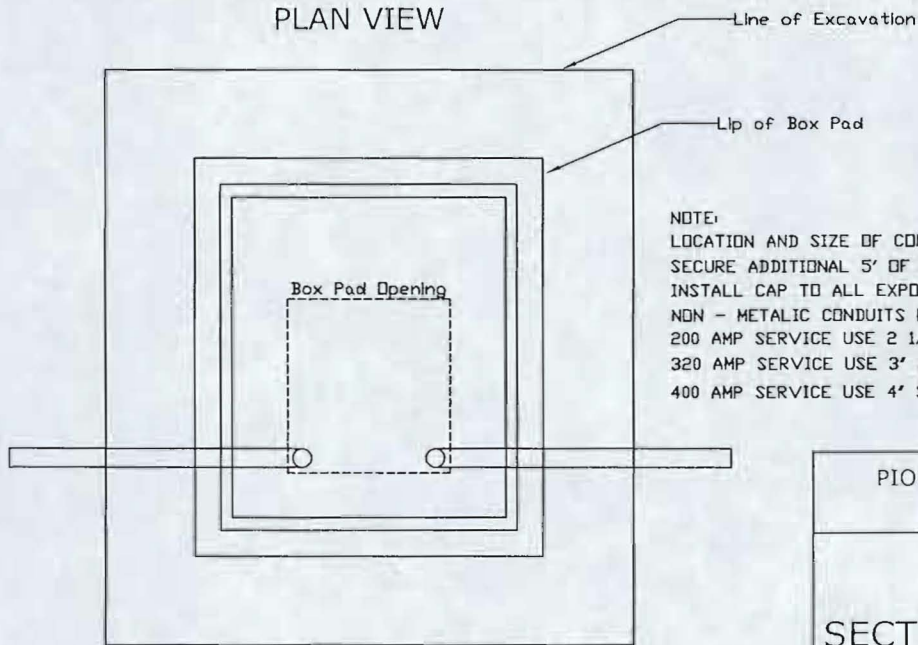

NOTE:
 LOCATION AND SIZE OF CONDUIT TO BE DETERMINED BY STAKING ENGINEER
 SECURE ADDITIONAL 5' OF PULL STRING/TAPE TO CONDUIT CAP
 INSTALL CAP TO ALL EXPOSED CONDUIT TO PREVENT WATER INGRESS
 NON - METALIC CONDUITS MUST BE INSTALLED
 200 AMP SERVICE USE 2 1/2' SCHEDULE 40 ELECTRICAL GRADE CONDUIT
 320 AMP SERVICE USE 3' SCHEDULE 40 ELECTRICAL GRADE CONDUIT
 400 AMP SERVICE USE 4' SCHEDULE 40 ELECTRICAL GRADE CONDUIT

PIONEER RURAL ELECTRIC CO-OP., INC.
 PIQUA, OHIO 45356

PRIMARY URD
 SECTIONALIZING ENCLOSURE

FRONT

Rev. 3/09

UM3 - 14