


TRANSFORMER BOX PAD
PLAN VIEW

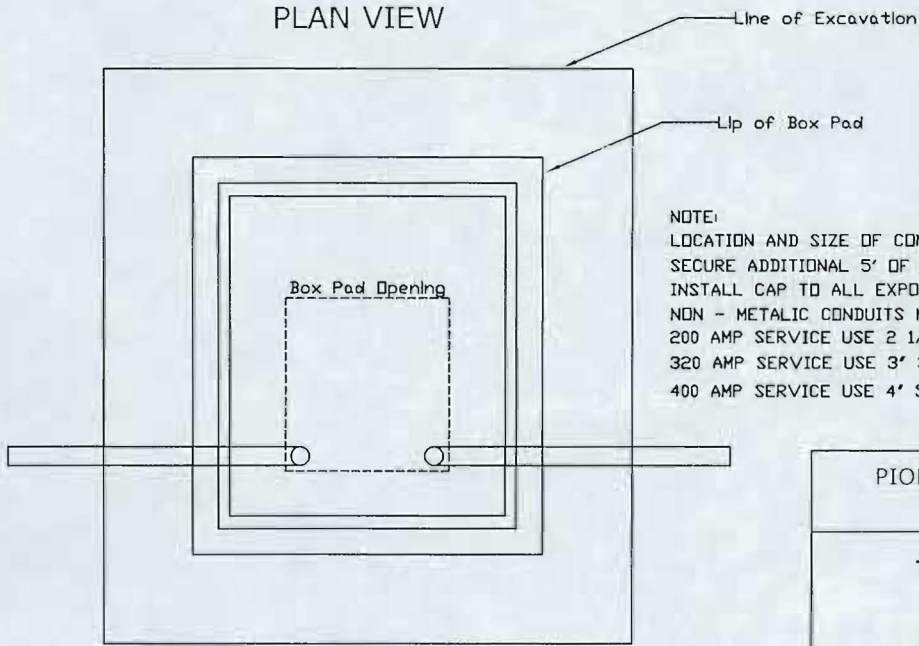

NOTE:
 LOCATION AND SIZE OF CONDUIT TO BE DETERMINED BY STAKING ENGINEER
 SECURE ADDITIONAL 5' OF PULL STRING/TAPE TO CONDUIT CAP
 INSTALL CAP TO ALL EXPOSED CONDUIT TO PREVENT WATER INGRESS
 NON - METALLIC CONDUITS MUST BE INSTALLED
 200 AMP SERVICE USE 2 1/2" SCHEDULE 40 ELECTRICAL GRADE CONDUIT
 320 AMP SERVICE USE 3" SCHEDULE 40 ELECTRICAL GRADE CONDUIT
 400 AMP SERVICE USE 4" SCHEDULE 40 ELECTRICAL GRADE CONDUIT

PIONEER RURAL ELECTRIC CO-OP., INC.
 PIQUA, OHIO 45356

TRANSFORMER BOX PAD

FRONT

Rev. 3/09

UM1 - 7NC